


ZASIP TOPLOVODA

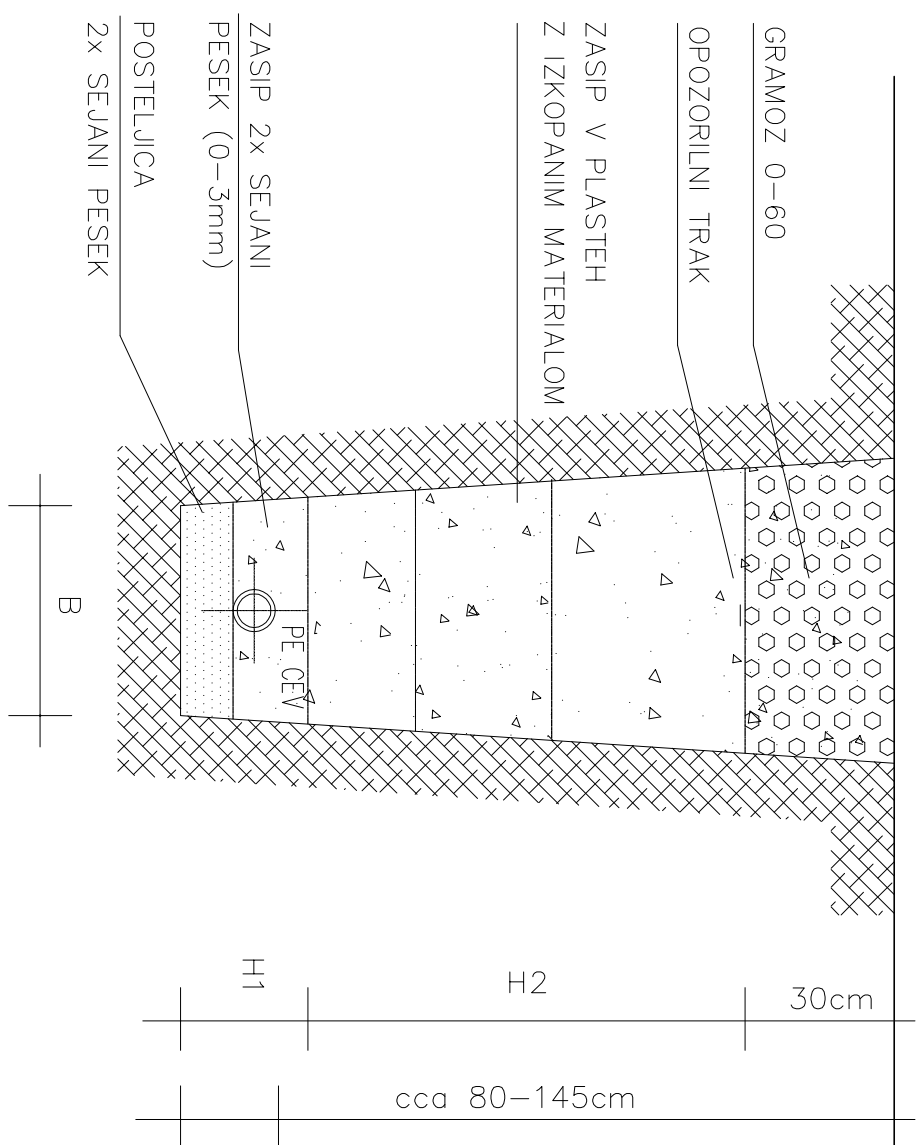


	B	H1	H2	H3	H4	TOT
Pe	40	40	47	25	8	120
90	40	40	47	25	8	120
110	40	40	47	25	8	120
125	40	40	47	25	8	120
160	40	45	47	25	8	125
180	45	45	47	25	8	125
200	45	50	47	25	8	130
225	50	55	47	25	8	135
250	50	55	47	25	8	135

KRÍŽANJE TOPLOVODA IN TK KABLOV

Y min. = 0,60m


TRAK ZA OZNAČBO TK. KABLOV

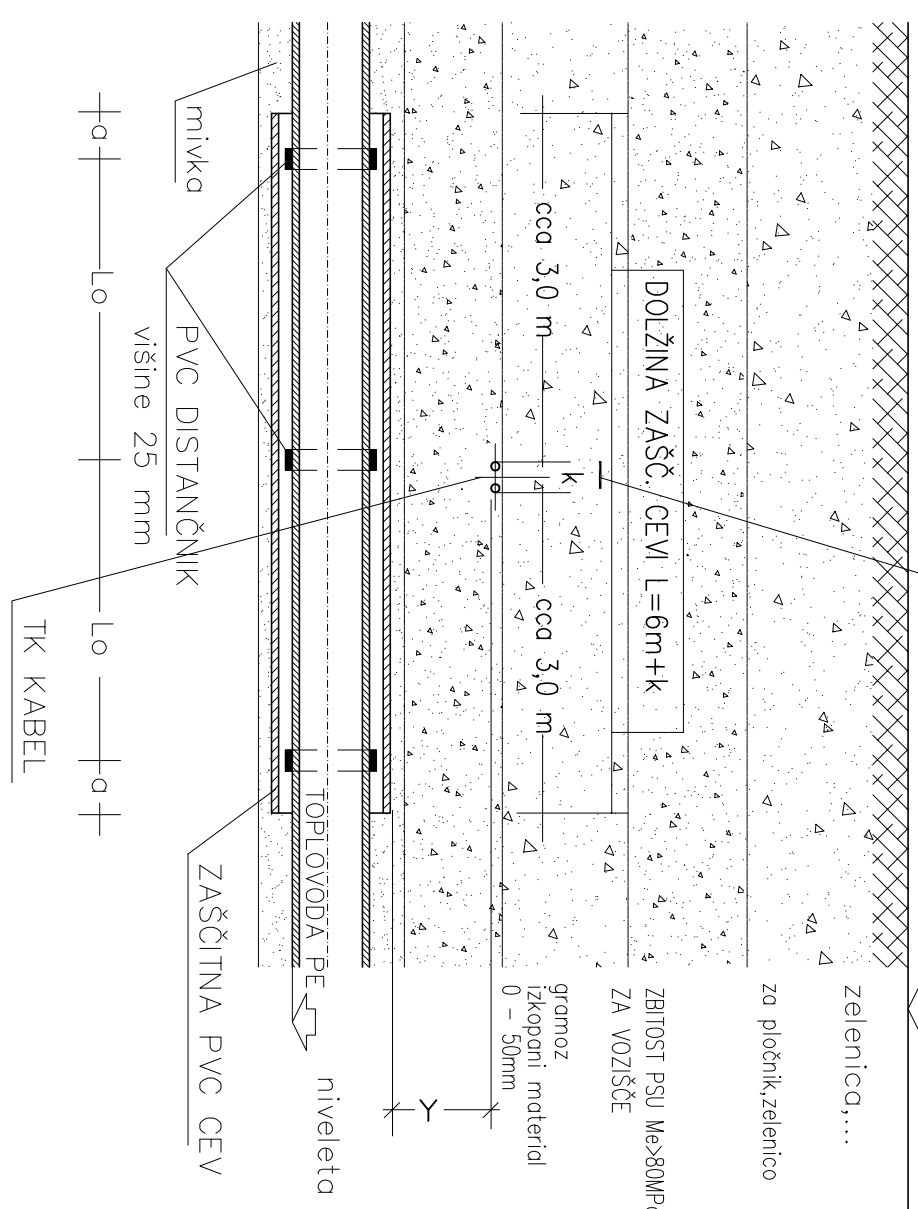

PE PLINSKA CEV	PE 63	PE 90	PE 110	PE 125	PE 160	PE 180	PE 225
ZASČITNA PVC CEV	ø 110	ø 160	ø 180	ø 225	ø 250	ø 280	ø 315
MAX. RAZDALJA L ₀	2 m	2 m	2 m	2 m	2 m	2 m	2 m
RAZDALJA Ø	0,35 m	0,30 m	0,30 m	0,30 m	0,20 m	0,20 m	0,20 m

OPOMBA : Zaščita s PVC je predvidena samo v primeru, da je γ dejanski $< \gamma$ min


ZASIP TOPLOVODA-CESTIŠČE

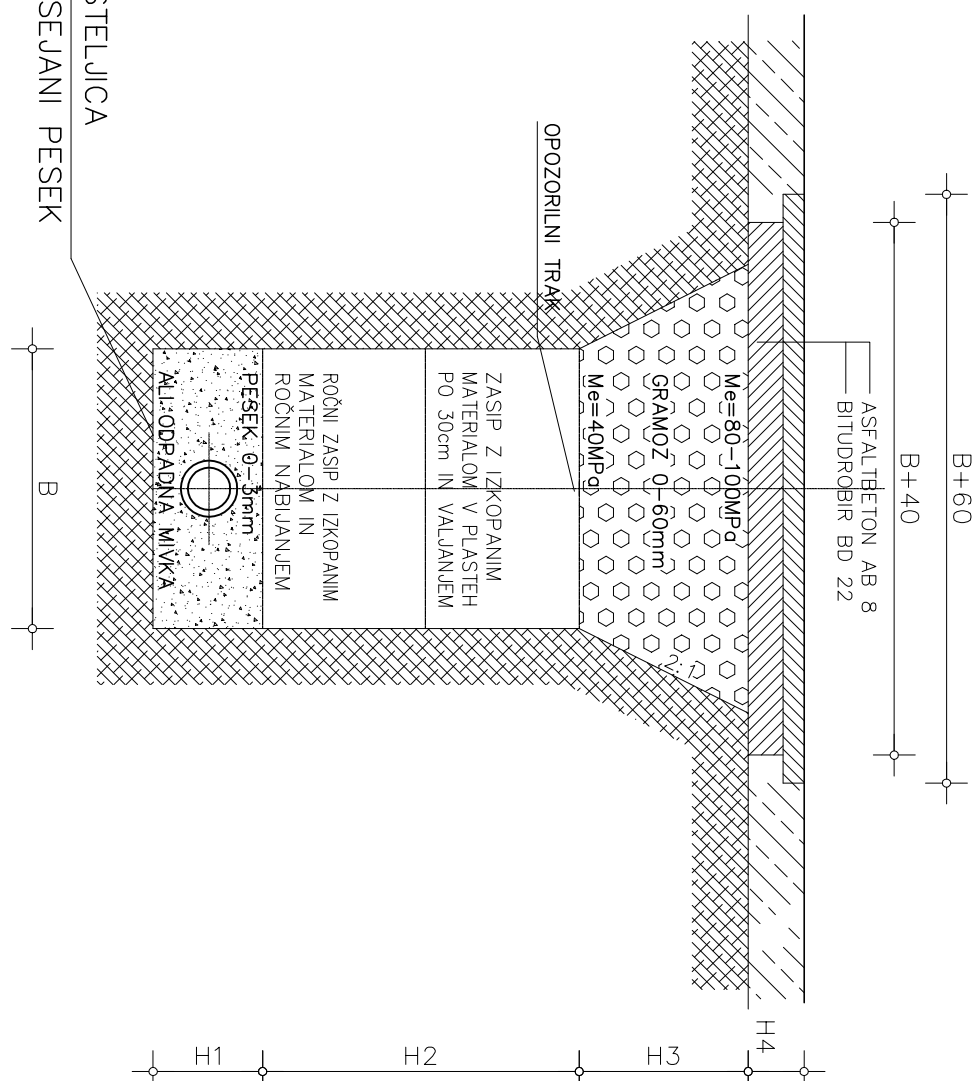

De	B	H1	H2	H3	H4	TOT
90	40	40	47	25	8	120
110	40	40	47	25	8	120
120	40	40	47	25	8	120
160	40	45	47	25	8	125
180	45	45	47	25	8	135
200	45	50	47	25	8	150
220	50	55	47	25	8	135
250	50	55	47	25	8	135
315	55	60	47	25	8	140
335	60	65	47	25	8	145

PRIBLIŽEVANJE TOPLOVODA IN TK KABLOV


X min = >1,50m, brez zaščitne cevi
X min = 0,6 do 1,50m, obvezna uporaba zaščitne cevi

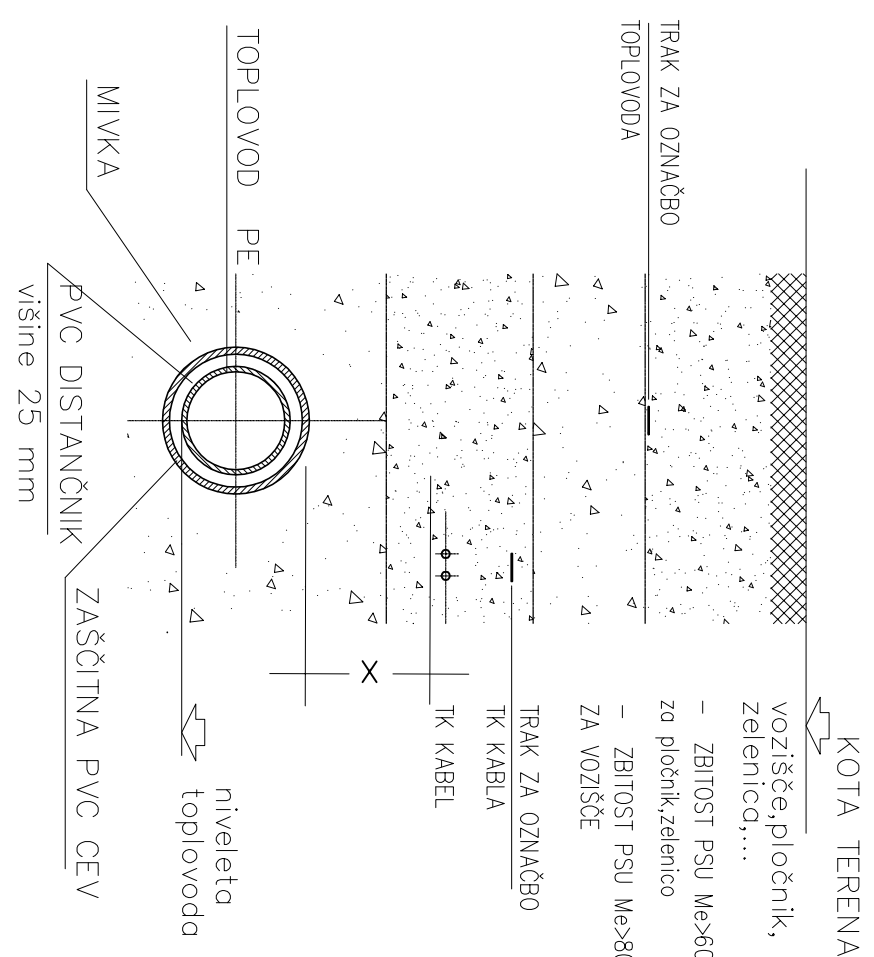

PE VODOVODNA CEV	63	PE 90	PE 110	PE 125	PE 160	PE 180	PE 225
ZAŠČITNA PVC CEV	Ø 110	Ø 160	Ø 180	Ø 225	Ø 250	Ø 280	Ø 315

KRÍŽANJE TOPLOVODA IN ELEKTRIČNIH KABLOV

Y min. = 0,50m

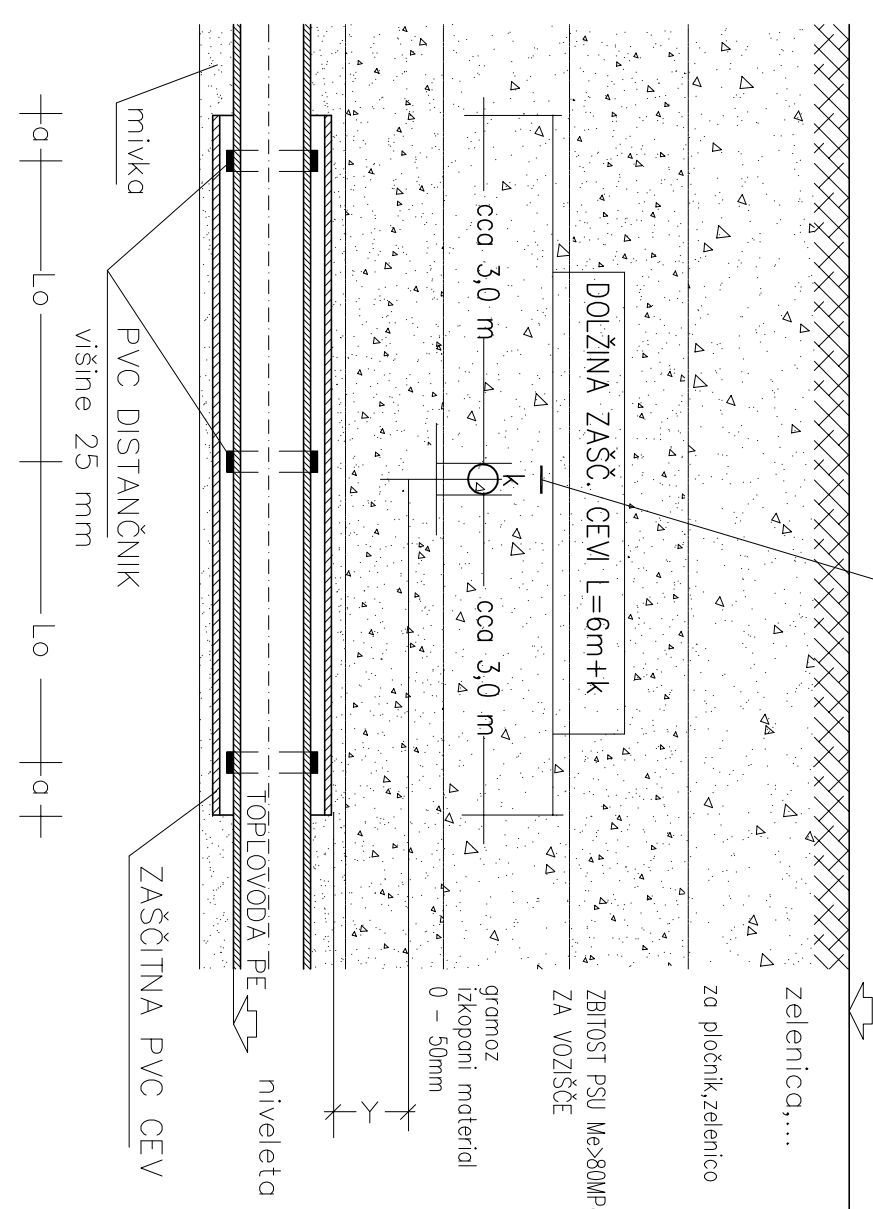


PE PLUNSKA CEV	PE 63	PE 90	PE 110	PE 125	PE 160	PE 180	PE 225
ZASČITNA PVC CEV	Ø 110	Ø 160	Ø 180	Ø 225	Ø 250	Ø 280	Ø 315
MAX. RAZDALJA L ₀	2 m	2 m	2 m	2 m	2 m	2 m	2 m
RAZDALJA Ø	0,35 m	0,30 m	0,30 m	0,30 m	0,20 m	0,20 m	0,20 m

OPOMBA : Zaščita s PVC je predvidena samo v primeru, da je $Y_{dejanski} < Y_{min}$

KRÍŽANJE TOPLOVODA IN PLINOVODA

Y min. = 0,20m	TRAK ZA OZNAČBO PLINOVODA
----------------	---------------------------

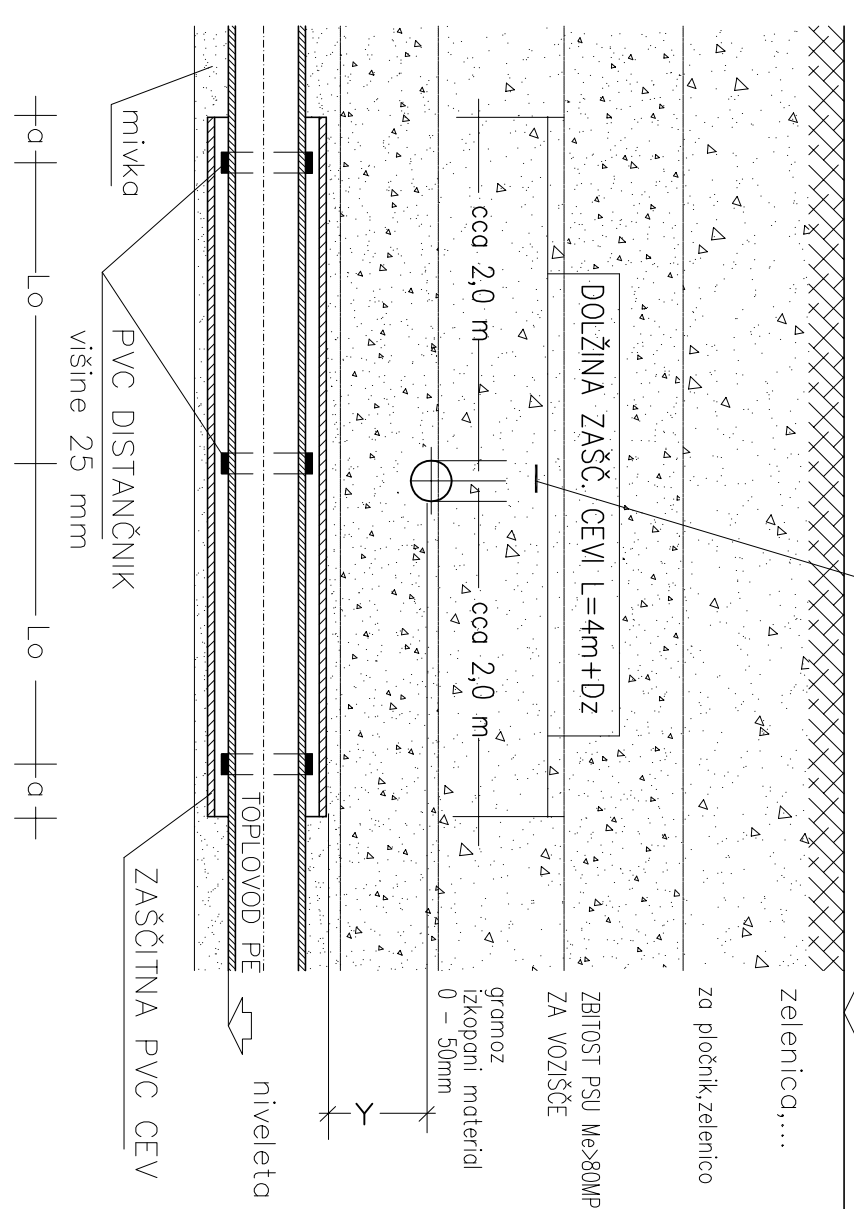


PE PLINSKA CEV	PE 63	PE 90	PE 110	PE 125	PE 160	PE 180	PE 225
ZASČITNA PVC CEV	ø 110	ø 160	ø 180	ø 225	ø 250	ø 280	ø 315
MAX. RAZDALJA Lg	2 m	2 m	2 m	2 m	2 m	2 m	2 m
RAZDALJA a	0,35 m	0,30 m	0,30 m	0,30 m	0,20 m	0,20 m	0,20 m

Kot križanja: 90° (tol. 10%)


PRIBLIŽEVANJE TOPLOVODA IN ELEKTRIČNIH KABLOV

X min = >1,50m, brez zaščitne cevi
X min = 0,3do1,50m, obvezna uporaba zaščitne cevi

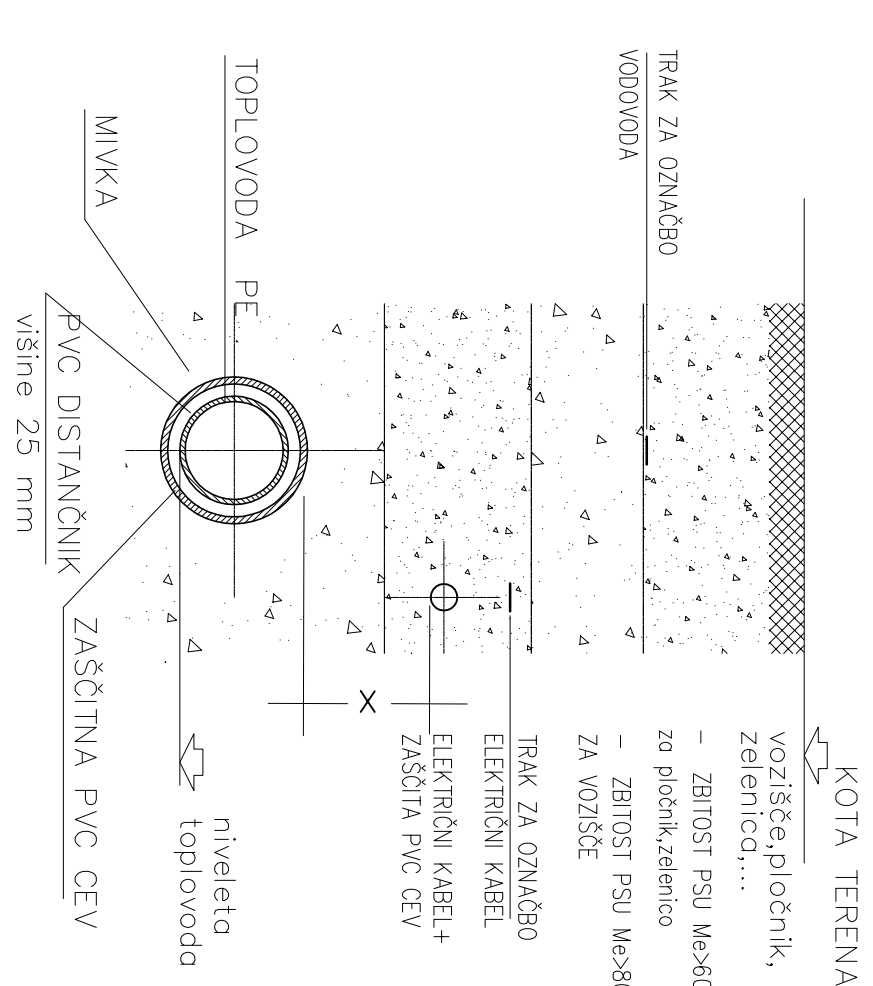

PE 1000/1000A CPEV	63	PE 90	PE 110	PE 125	PE 160	PE 180	PE 225
ZASČITNA PVC CPEV	ø 110	ø 160	ø 180	ø 225	ø 250	ø 280	ø 315

PRIBLIŽEVANJE TOPLOVODA IN PLINOVODA
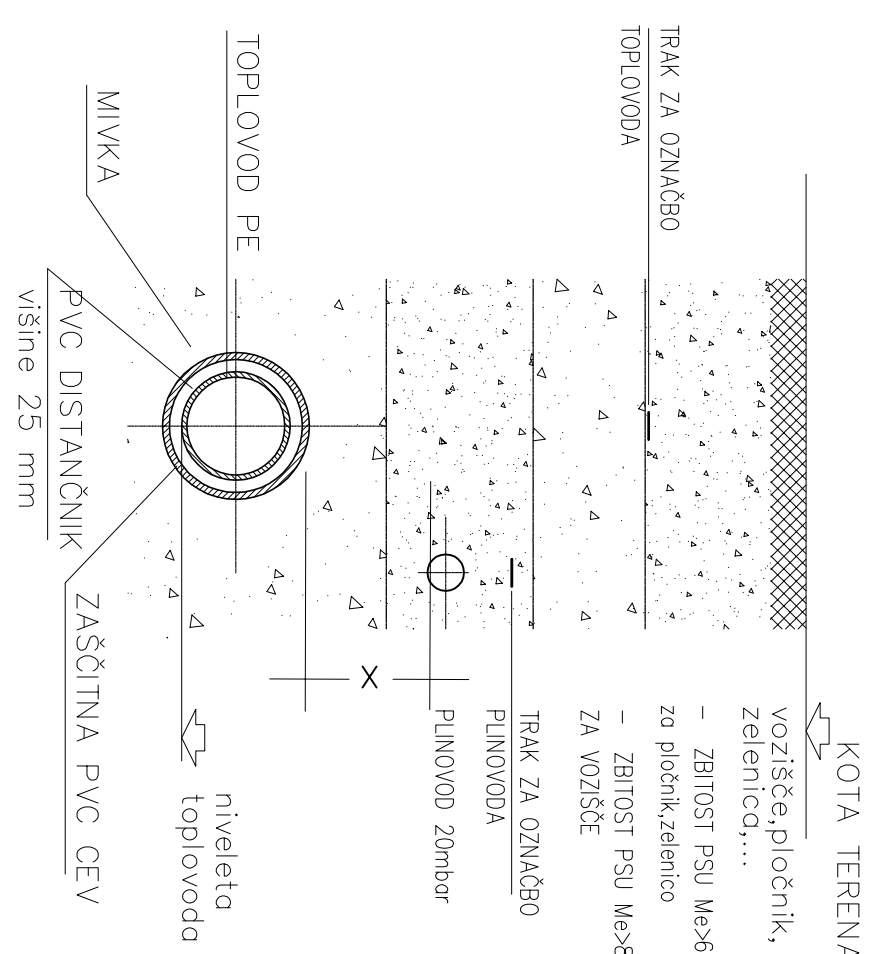
$$X_{\min} = 0,5m$$


PE TOPILOVODNA CEV	63	PE 90	PE 110	PE 125	PE 160	PE 180	PE 225
ZASČITNA PVC CEV	Ø 110	Ø 160	Ø 180	Ø 225	Ø 250	Ø 280	Ø 315

[illegible]